



SLOPE DETAIL
NO SCALE

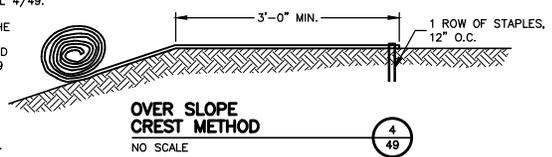


OVER SLOPE CREST METHOD
NO SCALE

DO NOT NEED TO TRENCH TRM IN IF IT CAN BE EXTENDED A MINIMUM OF 3'-0" OVER THE CREST OF THE SLOPE.

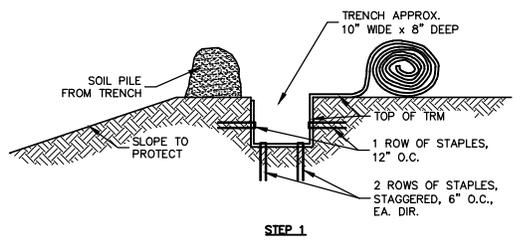


STEP 1

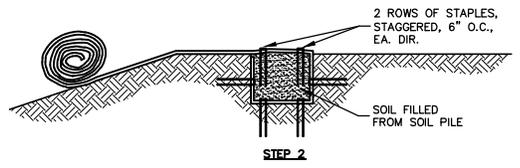


STEP 2


SLOPE TRENCHING METHOD "A"
NO SCALE

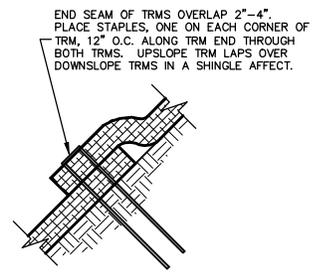


END ROLL OVERLAP
NO SCALE

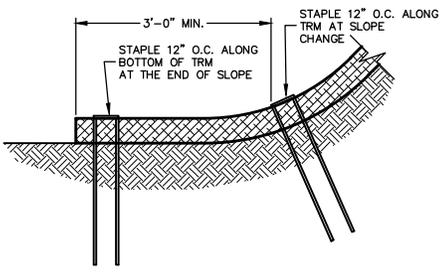

BOTTOM OF SLOPE TERMINATION IF INSTALLED 3' BEYOND THE TOE OF SLOPE
NO SCALE

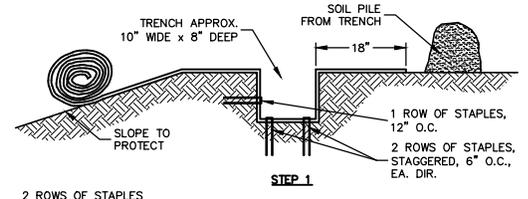


STEP 1

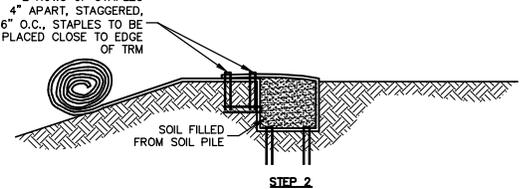

STEP 2

SLOPE TRENCHING METHOD "B"
NO SCALE

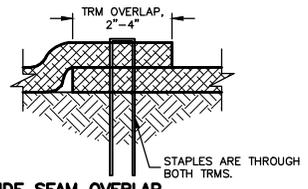


SIDE SEAM OVERLAP STAPLE DETAIL
NO SCALE


Curlex® Enforcer® Pattern Guide
For 8 ft wide Curlex Erosion Control Blankets
Adjust horizontal staple spacing for 4 ft and 16 ft wide Curlex Erosion Control Blankets

Application	Slope		
	≤ 4H:1V	≤ 3H:1V	≤ .5H:1V
Staple Pattern	A	B	C


● = Staple Placement

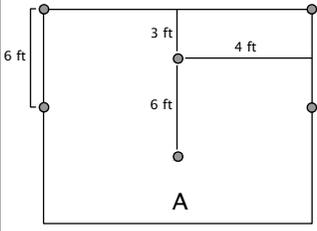

0.6 Staples / yd²

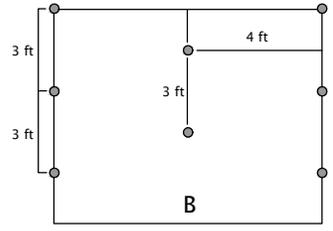


1.1 Staples / yd²

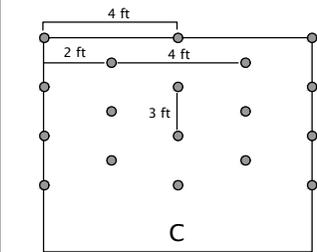

1.9 Staples / yd²

- Notes:
1. Recommended staples are minimum 4 in biodegradable E-Staples®, as provided by American Excelsior Company, or 6 in wire for cohesive soils and 6 in biodegradable E-staples®, as provided by American Excelsior Company, or 8 in wire for non-cohesive soils.
 2. For best results insert staples so heads are parallel to the flow of water.
 3. For additional pull-out resistance, consider using TL-TA2 Gripple twist anchors for tough/cohesive soils or TL-TA1 Gripple twist anchors for moderate/non-cohesive soils.
 4. Adjust staple pattern so staples are placed in critical slope points (e.g. slope change)



BOTTOM OF SLOPE TERMINATION IF INSTALLATION 3' BEYOND TOE OF SLOPE IS NOT POSSIBLE
NO SCALE

